# SURGE TANK

## Stainless Steel Access Ladders

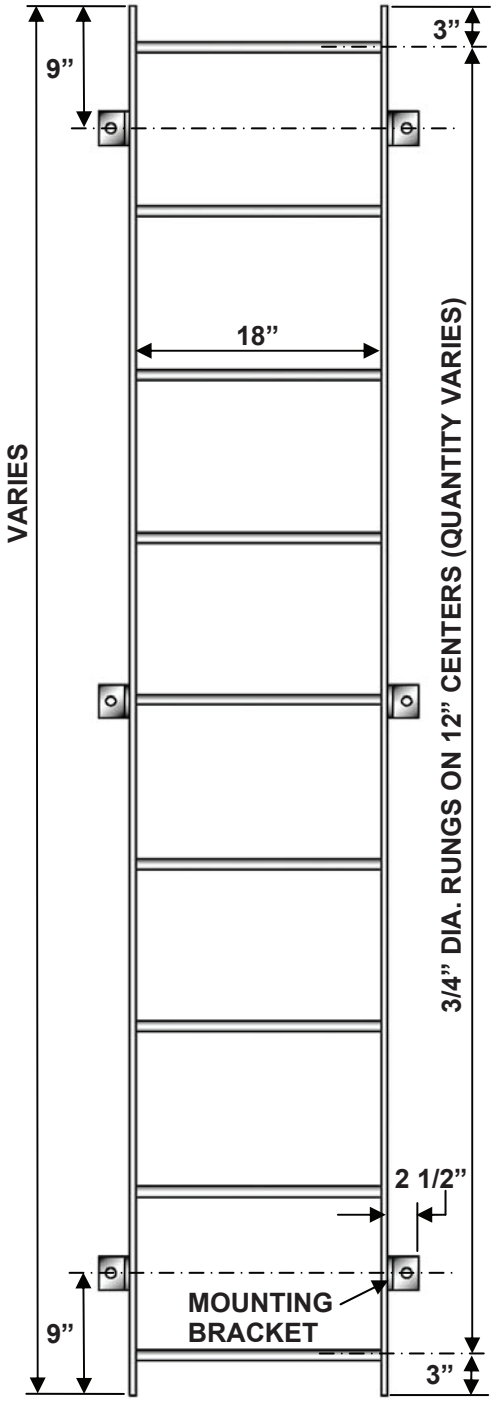


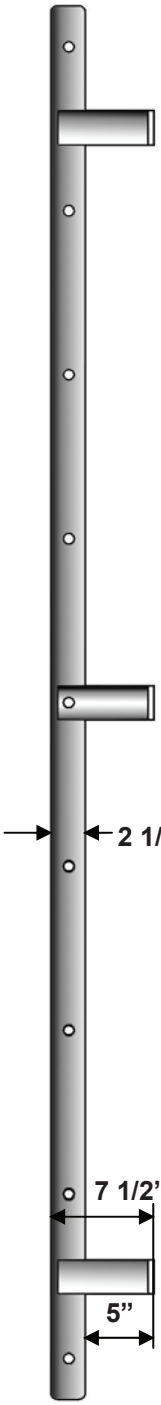

**CENTER MOUNTING BRACKETS FOR LADDERS OVER 78” LONG**

**LADDER RAILS AND BRACKETS ARE 1/4” THICK**
**1/2” S.S. MOUNTING HARDWARE NOT INCLUDED**
**1/2” S.S. MOUNTING HARDWARE NOT INCLUDED**

| Description | Part Numbers |
|---|---|
| LADDER SURGE TANK 2 RUNG | 160SSTL02R |
| LADDER SURGE TANK 3 RUNG | 160SSTL03R |
| LADDER SURGE TANK 4 RUNG | 160SSTL04R |
| LADDER SURGE TANK 5 RUNG | 160SSTL05R |
| LADDER SURGE TANK 6 RUNG | 160SSTL06R |
| LADDER SURGE TANK 7 RUNG | 160SSTL07R |
| LADDER SURGE TANK 8 RUNG | 160SSTL08R |
| LADDER SURGE TANK 9 RUNG | 160SSTL09R |
| LADDER SURGE TANK 10 RUNG | 160SSTL10R |
| LADDER SURGE TANK 11 RUNG | 160SSTL11R |
| LADDER SURGE TANK 12 RUNG | 160SSTL12R |
| LADDER SURGE TANK 13 RUNG | 160SSTL13R |
| LADDER SURGE TANK 14 RUNG | 160SSTL14R |

R-5/10/11

Neptune Benson evoqua

evoqua.com • 334 Knight St Suite 3100, Warwick, RI 02886
800.832.8002 • 401.821.2200 • Fax 401.821.7129

**SURGE TANK ACCESS LADDER**

A. Access ladder shall be a Neptune-Benson stainless steel ladder and shall be mounted inside the surge tank. Ladder shall be 18" wide with 2½" x 1/4" side rails. Length per plan.

B. Ladder rungs shall be ¾", diameter stainless steel rod spaced at 12" centers. 2½" x 1/4", stainless steel, angle clips shall be provided for mounting ladder to surge tank wall.